

Annexure C

PROFORMA FOR SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

No. H-M/20-06-25

Dated: 20.06.25

It is certified that an inspection team headed by ... Dr. Syed Rafi Ahmad, M.S

(Name of Officers with designation) from ... CHC, Laksa PHED

inspected the S.P.S. Public School, Near Durga Stone, Crasher, Vill Bhogpur Haridwar

(Name & Address of the school) on 20/06/2025 (date of inspection) and on the basis of

Water Test Report (Attached) bearing no. NCL/EP-039/04/01/25, dated 09/01/2025

of New Con Consultants A Laboratory PHED Lab) certified that the


S.P.S. Public School, Bhogpur Haridwar (Name of school) has safe drinking water

facilities for the students and members of staff of the institution. School is also maintains the

hygienic sanitation condition in the school building & the campus as per norms prescribed by the

Central/ State/ U.T. Govt.

This certificate is valid till 19.06.26.


Signature with Seal: 
Name: DR. SYED RAFI AHMA
Designation: MEDICAL SUPERINTENDENT
Name & Address of the Office/ Department: चिकित्सा अधीक्षक

To S.P.S. Public School
Near Durga Stone, Crasher, Vill Bhogpur Haridwar
(Name & Address of the Institution)
UTTARAKHAND PIN. 247663

साओ स्वाओ केन्द्र
लक्सर (हरिद्वार)

Note: The certificate is to be issued by authorized officer / PHED Lab / local bodies




PRINCIPAL
S.P.S. PUBLIC SCHOOL
BHOGPUR, HARIDWAR



Newcon Consultants & Laboratories



(GOVERNMENT APPROVED TESTING LABORATORIES)
An ISO 9001 : 2015, ISO 14001 : 2015, ISO 45001 : 2018 Certified Laboratory

TEST REPORT

Page No.: 1 of 2

TEST REPORT No. NCL/EP-039/04/01/25		ULR No.:TC126212500000103F	DATE OF REPORT : 09/01/2025
Name and Address of Customer	M/S S.P.S. PUBLIC SCHOOL Bhogur, Haridwar (Uttarakhand)		

SAMPLING DETAILS

Sample Name	: Drinking Water	Analysis End Date	: 09/01/2025
Analysis Start Date	: 04/01/2025	Sample ID No.	: NCL/EP-039/04/01/25
Date of Sampling	: 03/01/2025	Sample Receipt Date	: 04/01/2025
Time of Sampling	: 03:20 PM	Environmental Condition	: 27±2°C
Sampling Done By	: NCL		
Sample Description	: Drinking Water		
Sampling Location	: --		
Sampling Protocol	: IS : 17614 (P-1)	Sample Quantity	: 2 Ltr
Packing Condition	: Sealed	Packing	: PVC BOTTLE


TEST RESULT

S.No.	Parameters	Unit	Test Method	Result	Specification as IS : 10500, Amd. 2018	
					Desirable Limit	Permissible Limit
1	Colour	Hazen	IS:3025 (P-4)	BDL(DL-1.0)	5.0	15.0
2	Odour	-	IS:3025 (P-5)	Agreeable	Agreeable	Agreeable
3	Taste	-	IS:3025 (P-8)	Agreeable	Agreeable	Agreeable
4	Turbidity	NTU	IS:3025 (P-10)	BDL(DL-1.0)	1.0	5.0
5	pH Value	--	IS:3025 (P-11)	7.21	6.5-8.5	No Relaxation
6	Total Dissolved Solids	mg/L	IS:3025 (P-16)	98	500	2000
7	Total Hardness (as CaCO ₃)	mg/L	IS:3025 (P-21)	69.3	200	600
8	Calcium (as Ca)	mg/L	IS:3025 (P-40)	18.3	75	200
9	Magnesium (as Mg)	mg/L	APHA 3500 (mg)	5.7	30	100
10	Chloride (as Cl)	mg/L	IS:3025 (P-32)	14.4	250	1000
11	Sulphate (as SO ₄)	mg/L	IS:3025 (P-24)	BDL(DL-2.0)	200	400
12	Free Residual Chlorine (as Cl ₂)	mg/L	IS:3025 (P-26)	BDL(DL-0.1)	0.2	1.0
13	Iron (as Fe)	mg/L	IS:3025 (P-65)	BDL(DL-0.1)	1.0	No Relaxation
14	E. Coli	cfu/100 ml	IS:15185	Absent	Shall not be detectable in	Not Specified

EP-039/04/01/25-1



SONU
Section Incharge
Checked by



FOR NEWCON CONSULTANTS & LABORATORIES



1. The test report refers only to the particular sample/s submitted for testing and listed parameters.
2. Endorsement of the same is neither inferred nor implied.
3. Laboratory shall maintain the confidentiality of all information related to the samples & test reports.
4. Complaints about this report should be communicated within 10 days of the issue date of this report.
5. The report is not to be produced wholly or in part without prior permission of the Managing Partner. All disputes subject to Ghaziabad Jurisdiction.

Laboratory : A-1/156, Sector-17, (Swadeshi Compound) Kavi Nagar Industrial Area, GHAZIABAD - 201 002 (U.P.)

Mobile : 9810430345, 9205501788 | Website : www.newconlab.in

E-mail : newconlab@gmail.com, newconlabfinance@gmail.com



Newcon Consultants & Laboratories

(GOVERNMENT APPROVED TESTING LABORATORIES)
An ISO 9001 : 2015, ISO 14001 : 2015, ISO 45001 : 2018 Certified Laboratory




Page No.: 2 of 2

TEST REPORT No. NCL/EP-039/04/01/25 ULR No.:TC126212500000103F DATE OF REPORT :09/01/2025

S.No.	Parameters	Unit	Test Method	Result	Specification as IS : 10500, Amd. 2018	
					Desirable Limit	Permissible Limit
14					any 100 ml sample	
15	Total Coliform	cfu/100 ml	IS:15185	Absent	Shall not be detectable in any 100 ml sample	Not Specified

End of Report

Remarks : BDL = Below Detection Limit.

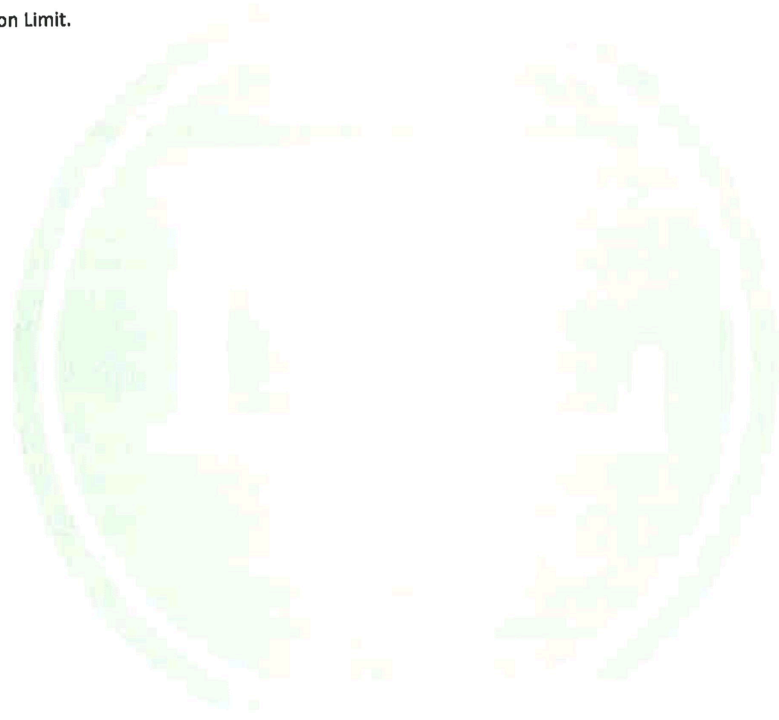

EP-039/04/01/25-2



ISHA TYAGI
Jr. Analyst
Checked by

FOR NEWCON CONSULTANTS & LABORATORIES



1. The test report refers only to the particular sample/s submitted for testing and listed parameters.
2. Endorsement of the same is neither inferred nor implied.
3. Laboratory shall maintain the confidentiality of all information related to the samples & test reports.
4. Complaints about this report should be communicated within 10 days of the issue date of this report.
5. The report is not to be produced wholly or in part without prior permission of the Managing Partner. All disputes subject to Ghaziabad Jurisdiction.

Laboratory : A-1/156, Sector-17, (Swadeshi Compound) Kavi Nagar Industrial Area, GHAZIABAD - 201 002 (U.P.)

Mobile : 9810430345, 9205501788 | Website : www.newconlab.in

E-mail : newconlab@gmail.com, newconlabfinance@gmail.com

JAIVIR SINGH
Digitally signed by JAIVIR SINGH
Date: 2025.06.27 08:59:33 +05'30'

Sneh
Digitally signed by Sneh
Date: 2025.06.27 09:09:42 +05'30'